TOTAL UNITS REQUIRED: _____

DEPTH OF CONDUIT

(REQUIRED):


HEIGHT (REQUIRED):

HEIGHT EXPOSED

3" MIN.

3" MIN.

SECTION A-A

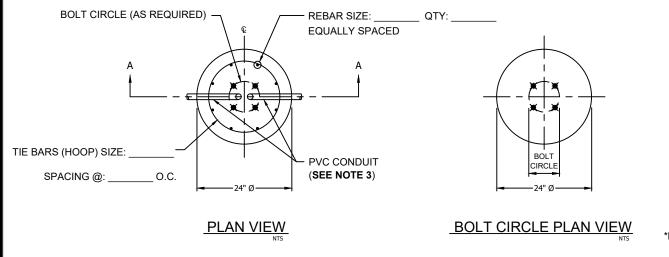

1" x 45° CHAMFER

(SEE NOTE 3)

- TIE BARS (HOOP)

ANCHOR BOLTS PER LIGHT POLE MANUFACTURER'S REQUIREMENT.

PVC CONDUIT (PER PLAN VIEW)

* SEE NOTE 3

TYPE A	TYPE B	TYPE C	TYPE D	TYPE E

CONTRACTOR NOTE:

CONTRACTOR TO PROVIDE NUMBER OF EACH POLE BASE LAYOUT REQUIRED FOR ORDER. (PLEASE USE ABOVE SCHEMATIC)

*POLE BASE INFO TABLE			
PVC CONDUIT SIZE:			
ANCHOR BOLT SIZE:			
BOLT CIRCLE FOR ANCHORS:			
BOLT/CONDUIT PROJECTION:			

*NOTE: TABLE MUST BE COMPLETED PRIOR TO PRODUCTION RELEASE.

GENERAL NOTES:

- 1) CONCRETE TO TEST 4,000 PSI AT 28 DAYS.
- 2) REINFORCING STEEL PER ASTM A615, GRADE 60, UNCOATED BLACK BARS.
- 3) IF SUPPLIED BY CONTRACTOR, ANCHOR BOLTS, BOLT TEMPLATE AND/OR UNASSEMBLED CONDUIT TO BE DELIVERED TO A&R PRIOR TO FABRICATION. STRUCTURES WILL NOT BE SCHEDULED FOR PRODUCTION UNTIL ALL COMPONENTS ARE AT A&R PLANT.

CONTRACTOR NOTES/COMMENTS:

PVC CONDUIT COUR (SEE NOTE 3)	PLER (TYP.)		
REBAR SIZE: EQUALLY SPACED	QTY:	CONTACT:	
TIE BARS (HOOP) SIZE: O.C.			Mills, New York, 12577 oncrete.com
	A&R JOB #:		DATE:
N	NOTE: This form is also a cut sheet. By signing below, contractor approves release for production.	PRECAST CONCRETE LIGHT POLE BASE 24"Ø	REV.:
		·	DWN.BY: A&R LLC
	X	CONTRACTOR:	DWG. NO.: LPB24