

TOTAL UNITS REQUIRED:

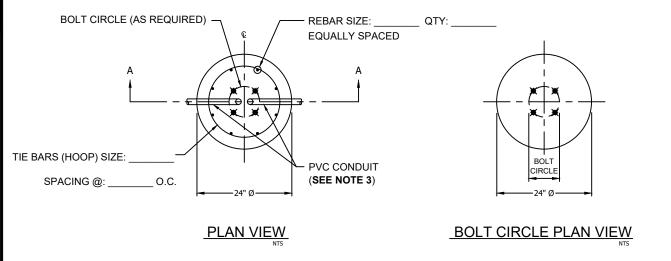

* SEE NOTE 3



CONTRACTOR NOTE:

CONTRACTOR TO PROVIDE NUMBER OF EACH POLE BASE LAYOUT REQUIRED FOR ORDER. (PLEASE USE ABOVE SCHEMATIC)

*POLE BASE INFO TABLE	
PVC CONDUIT SIZE:	
ANCHOR BOLT SIZE:	
BOLT CIRCLE FOR ANCHORS:	
BOLT/CONDUIT PROJECTION:	

*NOTE: TABLE MUST BE COMPLETED PRIOR TO PRODUCTION RELEASE.

GENERAL NOTES:

- 1) CONCRETE TO TEST 4,000 PSI AT 28 DAYS.
- 2) REINFORCING STEEL PER ASTM A615, GRADE 60, UNCOATED **BLACK BARS.**
- 3) IF SUPPLIED BY CONTRACTOR, ANCHOR BOLTS, BOLT TEMPLATE AND/OR UNASSEMBLED CONDUIT TO BE DELIVERED TO A&R PRIOR TO FABRICATION. STRUCTURES WILL NOT BE SCHEDULED FOR PRODUCTION UNTIL ALL COMPONENTS ARE AT A&R PLANT.

CONTRACTOR NOTES/COMMENTS:

,		
PLER (TYP.)		
_ QTY:	CONTACT:	
E:O.C.		Mills, New York, 12577 ncrete.com
A&R JOB #:		DATE:
	PRECAST CONCRETE LIGHT POLE BASE 24"Ø	REV.:
contractor approves release for production.	, and the second	DWN.BY: A&R LLC
X	CONTRACTOR:	DWG. NO.: LPB24

